

153 Series

Surface Mounted Troffer



DIMENSIONS

All dimensions are inches. Specifications subject to change without notice.


1' x 4'



2' x 4'



2' x 2'

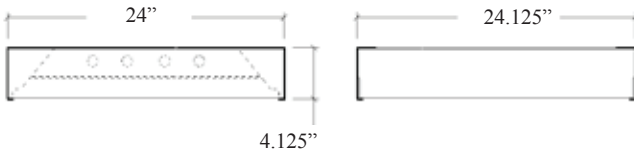

PHOTOMETRICS

Calculated using the zonal cavity method in accordance with IESNA LM41 procedure. Lamp configurations shown are

Floor	20%	20%	20%	20%	20%	20%	20%	20%	20%
Ceiling	80%	80%	80%	70%	70%	70%	50%	50%	50%
Wall	70%	50%	30%	70%	50%	30%	50%	30%	10%
RCR	Zonal cavity coefficients			153A232			Spacing ratio. Along 1.2 Across 1.3		
0	1.00	1.00	1.00	0.98	0.97	0.97	0.92	0.93	0.92
1	0.92	0.88	0.84	0.90	0.86	0.83	0.88	0.80	0.78
2	0.85	0.78	0.72	0.83	0.76	0.71	0.73	0.69	0.65
3	0.78	0.69	0.62	0.76	0.68	0.61	0.65	0.60	0.56
4	0.72	0.62	0.54	0.70	0.61	0.54	0.59	0.53	0.48
5	0.66	0.55	0.48	0.64	0.54	0.47	0.53	0.47	0.42
6	0.61	0.50	0.42	0.60	0.49	0.42	0.48	0.41	0.37
7	0.57	0.45	0.38	0.56	0.45	0.38	0.44	0.37	0.33
8	0.53	0.42	0.35	0.52	0.41	0.34	0.40	0.34	0.30
9	0.50	0.38	0.31	0.49	0.38	0.31	0.37	0.31	0.27
10	0.47	0.35	0.29	0.45	0.35	0.29	0.34	0.28	0.24

Floor	20%	20%	20%	20%	20%	20%	20%	20%	20%
Ceiling	80%	80%	80%	70%	70%	70%	50%	50%	50%
Wall	70%	50%	30%	70%	50%	30%	50%	30%	10%
RCR	Zonal cavity coefficients			153A332			Spacing ratio. Along 1.2 Across 1.3		
0	0.94	0.94	0.93	0.92	0.91	0.91	0.87	0.87	0.87
1	0.87	0.83	0.79	0.84	0.81	0.78	0.78	0.75	0.73
2	0.8	0.73	0.68	0.78	0.72	0.67	0.69	0.65	0.61
3	0.73	0.65	0.58	0.71	0.64	0.58	0.61	0.56	0.52
4	0.68	0.58	0.51	0.66	0.57	0.51	0.55	0.5	0.45
5	0.62	0.52	0.45	0.61	0.51	0.45	0.5	0.44	0.4
6	0.58	0.47	0.4	0.56	0.46	0.4	0.45	0.39	0.35
7	0.54	0.43	0.36	0.52	0.42	0.36	0.41	0.35	0.31
8	0.5	0.39	0.33	0.49	0.39	0.32	0.38	0.32	0.28
9	0.47	0.36	0.3	0.46	0.36	0.3	0.35	0.29	0.25
10	0.44	0.33	0.27	0.43	0.33	0.27	0.32	0.27	0.23

Floor	20%	20%	20%	20%	20%	20%	20%	20%	20%
Ceiling	80%	80%	80%	70%	70%	70%	50%	50%	50%
Wall	70%	50%	30%	70%	50%	30%	50%	30%	10%
RCR	Zonal cavity coefficients			153A432			Spacing ratio. Along 1.2 Across 1.3		
0	0.95	0.94	0.94	0.93	0.92	0.92	0.88	0.88	0.87
1	0.87	0.83	0.8	0.85	0.82	0.78	0.78	0.76	0.73
2	0.8	0.74	0.68	0.78	0.72	0.67	0.69	0.65	0.62
3	0.74	0.65	0.59	0.72	0.64	0.58	0.62	0.57	0.53
4	0.68	0.59	0.52	0.66	0.57	0.51	0.56	0.5	0.46
5	0.63	0.52	0.45	0.61	0.52	0.45	0.5	0.44	0.4
6	0.58	0.47	0.4	0.56	0.47	0.4	0.45	0.39	0.35
7	0.54	0.43	0.36	0.53	0.42	0.36	0.41	0.35	0.31
8	0.51	0.4	0.33	0.49	0.39	0.33	0.38	0.32	0.28
9	0.47	0.36	0.3	0.46	0.36	0.3	0.35	0.29	0.25
10	0.44	0.33	0.27	0.43	0.33	0.27	0.32	0.27	0.23

Floor	20%	20%	20%	20%	20%	20%	20%	20%	20%
Ceiling	80%	80%	80%	70%	70%	70%	50%	50%	50%
Wall	70%	50%	30%	70%	50%	30%	50%	30%	10%
RCR	Zonal cavity coefficients			153A232M20			Spacing ratio. Along 1.2 Across 1.2		
0	1.04	1.03	1.02	1.01	1.01	1.00	0.96	0.96	0.95
1	0.96	0.92	0.88	0.93	0.90	0.86	0.86	0.83	0.81
2	0.88	0.81	0.76	0.86	0.80	0.74	0.77	0.72	0.69
3	0.81	0.72	0.66	0.79	0.71	0.65	0.69	0.63	0.59
4	0.75	0.65	0.58	0.73	0.64	0.57	0.62	0.56	0.52
5	0.70	0.59	0.51	0.68	0.58	0.51	0.56	0.50	0.45
6	0.65	0.53	0.46	0.63	0.52	0.45	0.51	0.45	0.40
7	0.60	0.49	0.41	0.59	0.48	0.41	0.47	0.40	0.36
8	0.56	0.45	0.38	0.55	0.44	0.37	0.43	0.37	0.33
9	0.53	0.41	0.34	0.52	0.41	0.34	0.40	0.34	0.29
10	0.49	0.38	0.31	0.48	0.38	0.31	0.37	0.31	0.27

Catalog Number:
Notes:

Texas Fluorescents
 2055 Luna Rd. Suite 142 Carrollton, TX 75006
 Phone: 972-247-3171 Fax: 972-247-0200

www.texasfluorescents.com email: sales@texasfluorescents.com